


45m
Hose distance from back of Fire Appliance to demonstrate compliance with Part B.

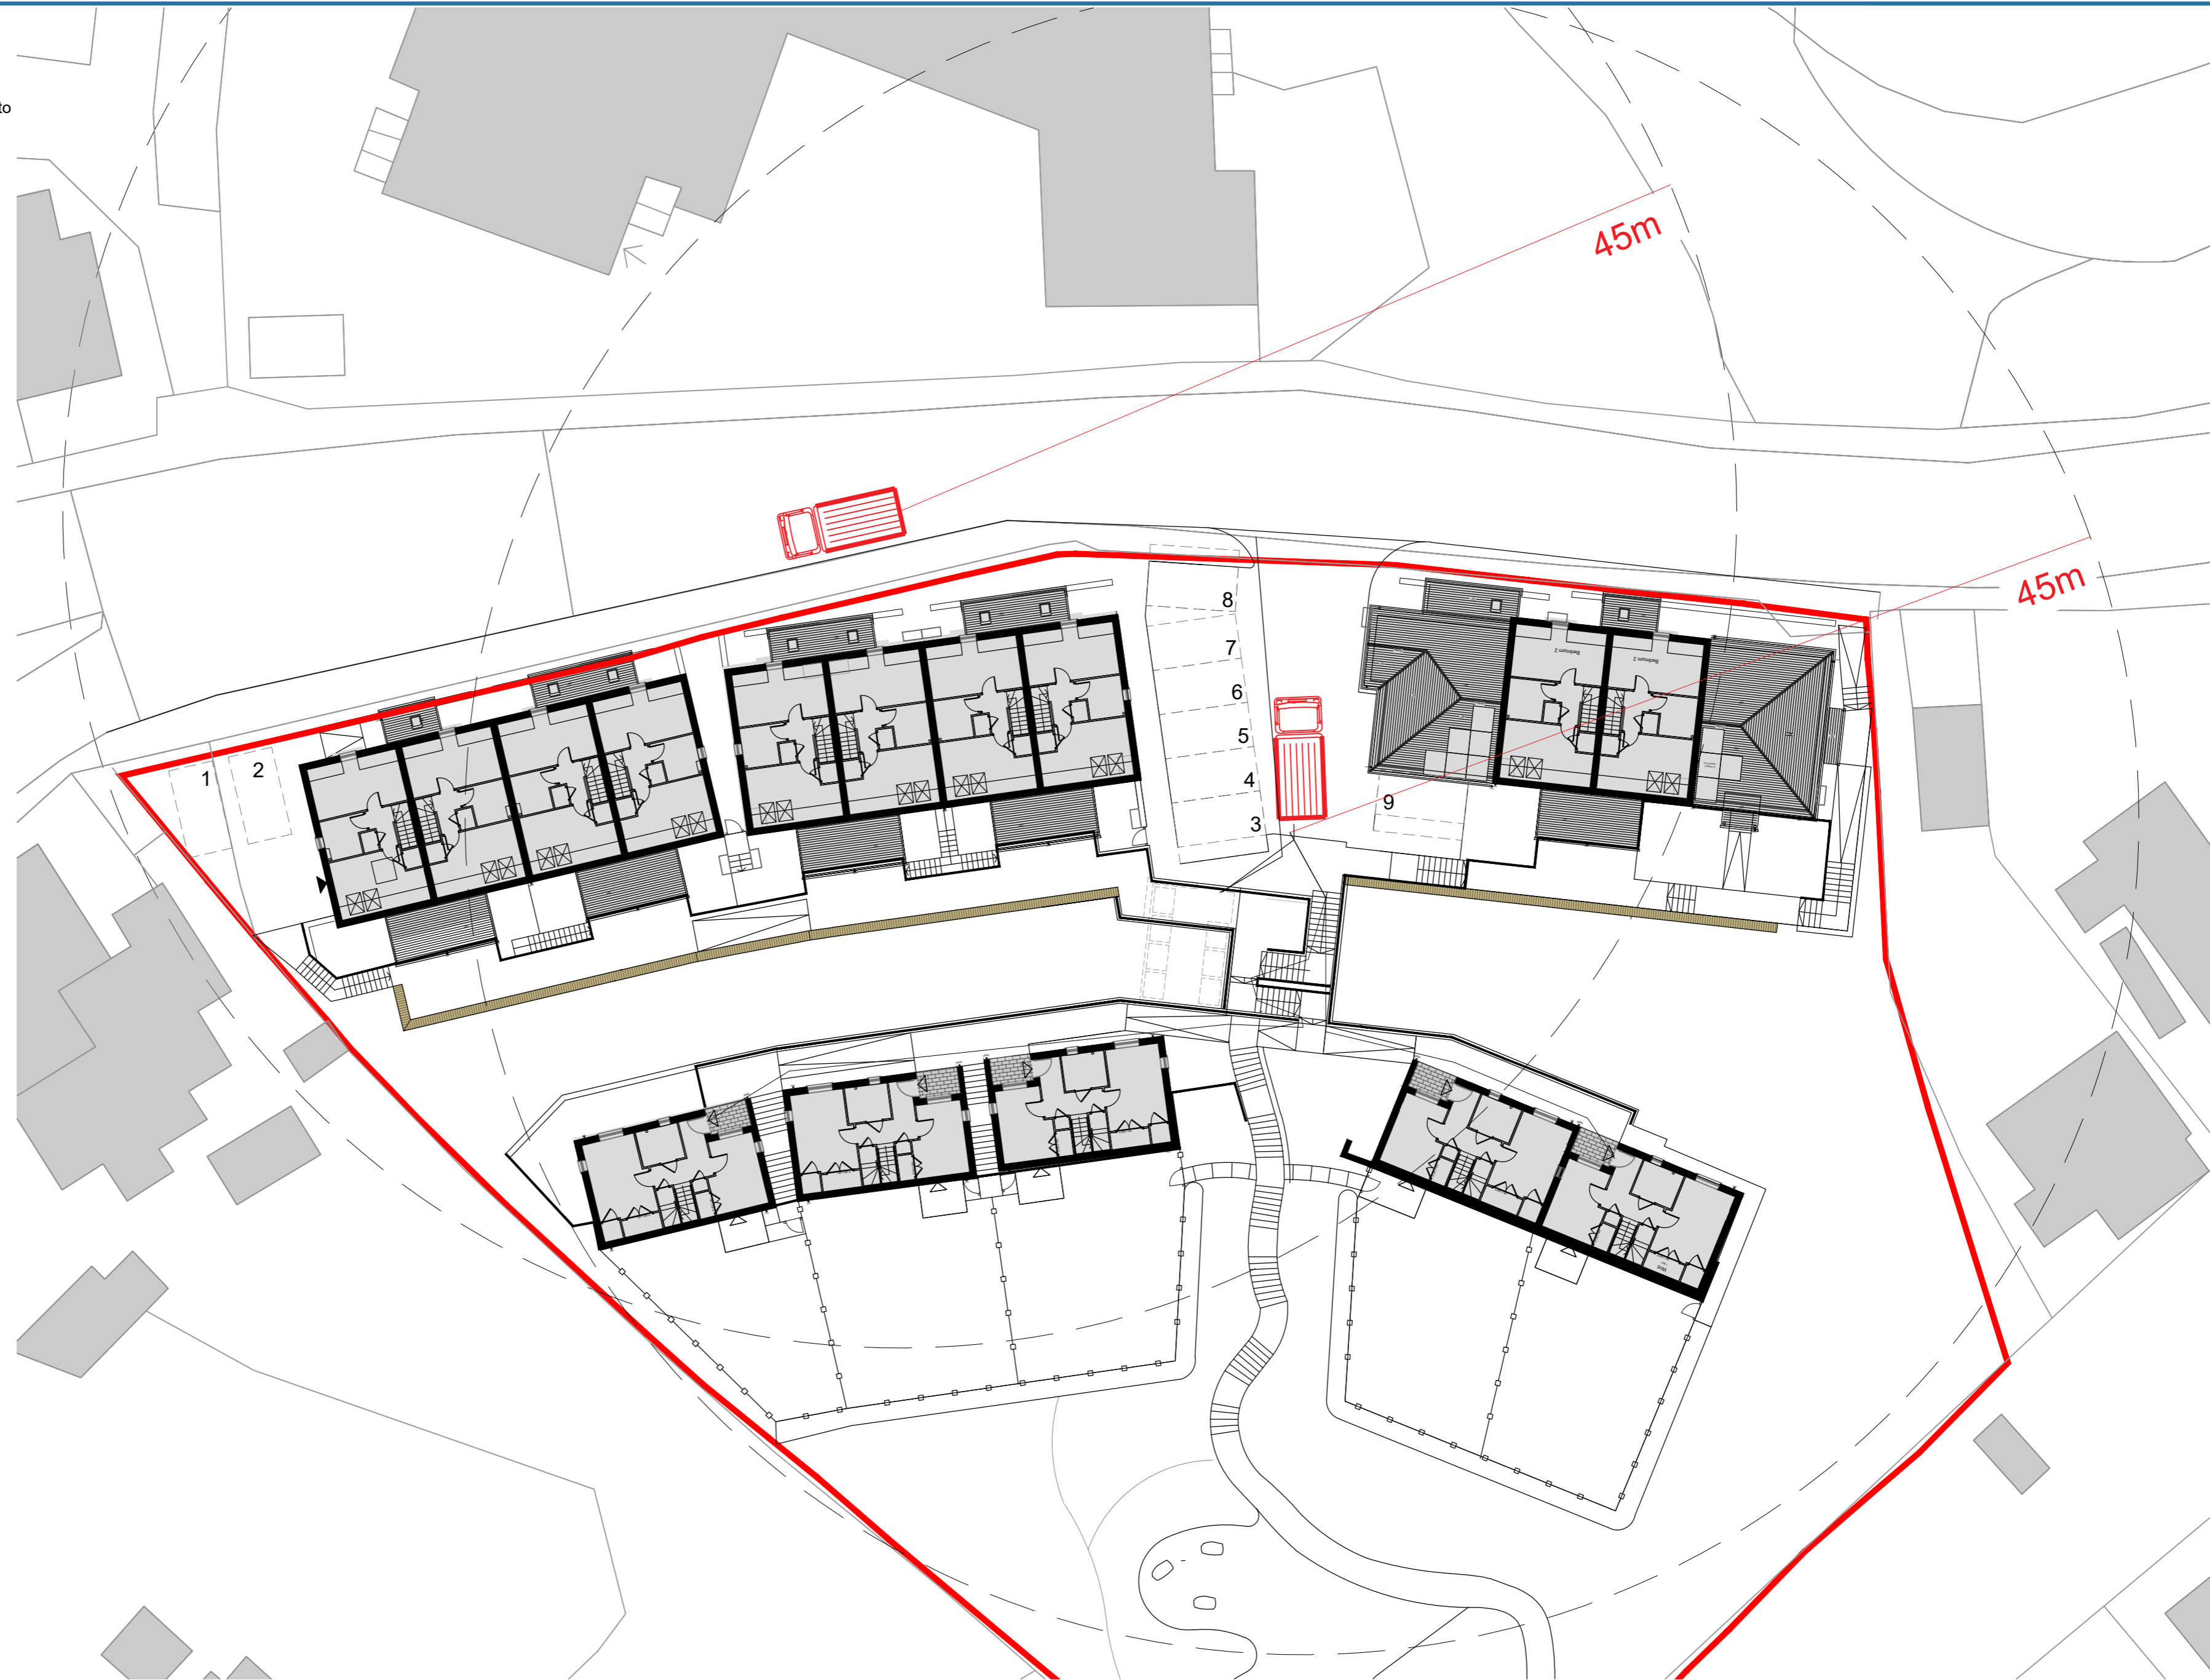

Project:
Title:
Client:
Date:
Drawn by:
Checked by:
Scale:
Drawing No.:

Carn Thomas, Isles of Scilly
Fire Appliance Access Plan
Livewest
Mar 2024
RIA
DMA
1:250 @ A2
21024_FAAP_

Rev.: A

19.08.24
date

A
rev

Published for planning submission
comment

RECEIVED
By Liv Rickman at 11:54 am, Aug 22, 2024

