


RECEIVED

By Liv Rickman at 11:35 am, Aug 15, 2024

Generator-01
220KW / 275KVA @0.8 Standby
generator 6400L x 1600W x 2500H)
c/w 65dba acoustic enclosure

ASHP-??
Air source heat pump 27kW

Fuel Tank-01
72 hour metal bund fuel tank
(2500L x 1000w x 2000H)

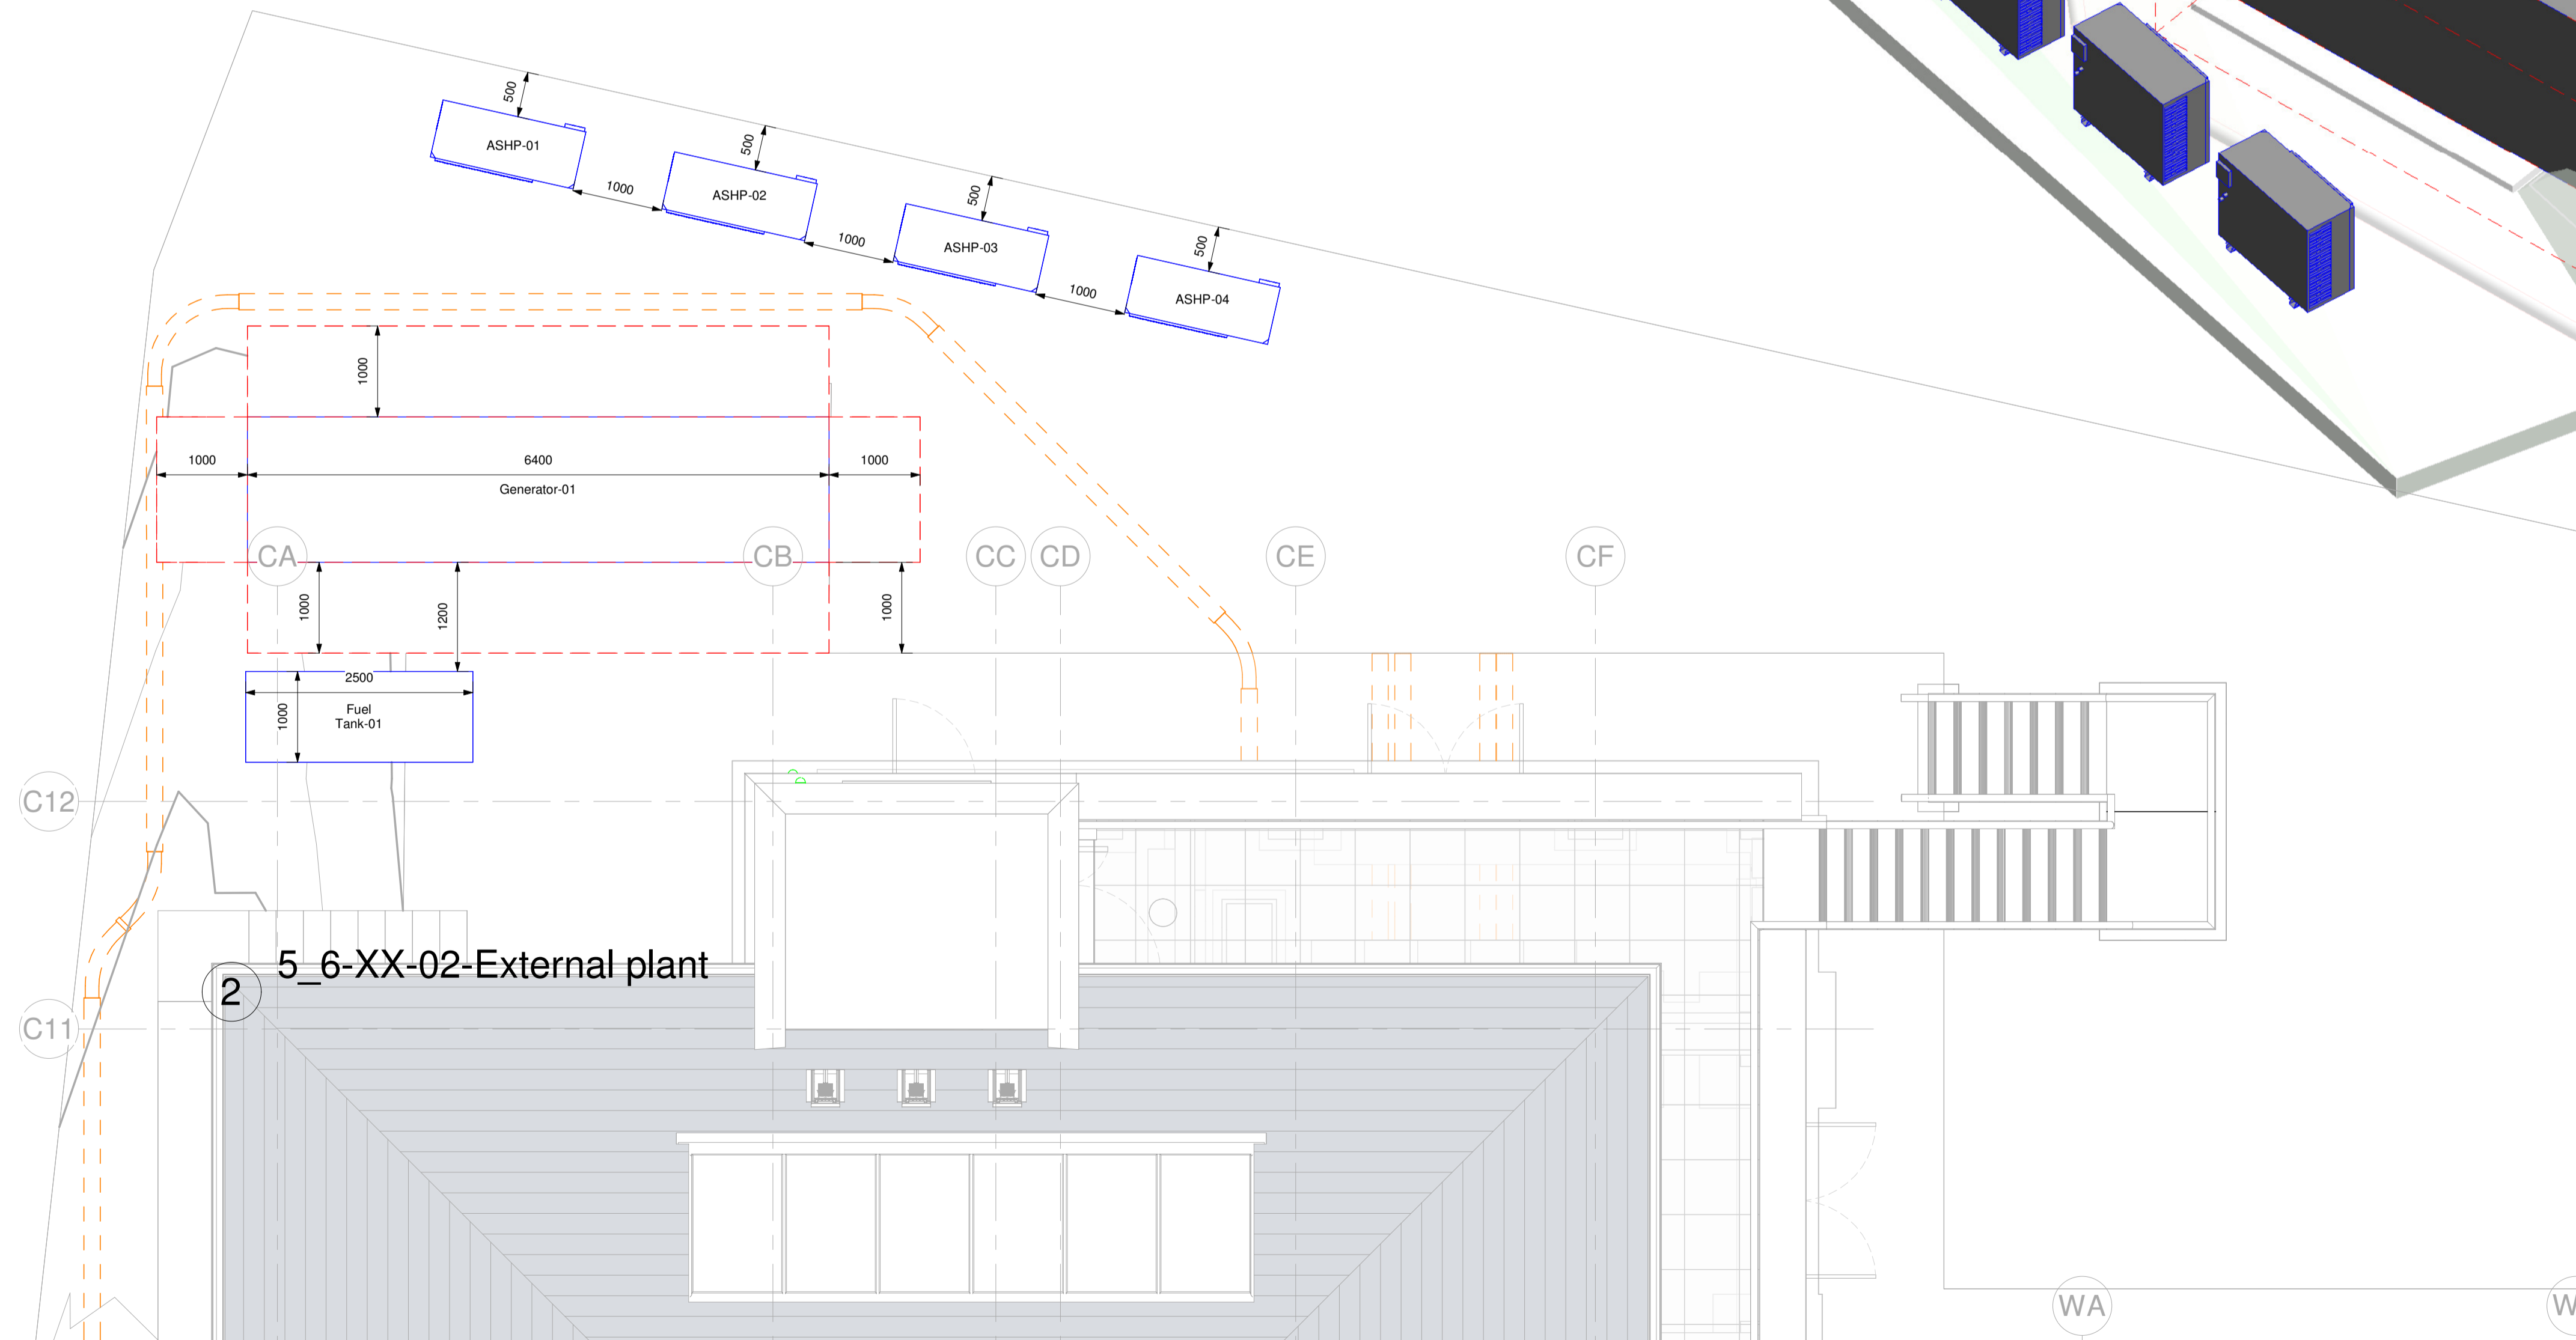

2 5_6-XX-02-External plant

1 5_6-01-01-COORDINATION EXTERNAL PLANT
1 : 50

Date	Description	Rev.	By
Revision Description			

hulley & kirkwood
Glasgow
Head Office
Watermark Business Park
Govan Road
Glasgow
G51 2SE
T: 0141 332 5466
E: hk.glasgow.hulley.co.uk

...Making Buildings Work

Project: IoS Integrated Health & Social Care Facility						
Drawing Title: EXTERNAL PLANT						
ISO 19650 Drawing Number: P0696-HAK-XX-ZZ-DR-ME-5_601						
Project	Originator	Functional Breakdown	Spatial Breakdown	Form	Discipline	ServiceNumber
		1 : 50				04/06/2024
Scale:			Creation Date:			
Revision:			Rev Date:			
Drawn By: TH		Checked By: CMcC				
		Approved By: CMcC				
Arch Rev: P05						
Struct Rev: P06						
Issue Status: STAGE 4						